


MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	J.R.V.R.	FECHA: DATE: DATE:	01/02/08	SERIE :	RXH/V	MODELO: MODELE:	50/65/80 95/120/155	EQUIPO AUTONOMO CONDENSADO POR AGUA HORIZONTAL/VERTICAL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT	
MODIFICACION: MODIFICATION:	MAGNETOTERMICOS -			v° B°		NP:	08025843	ARMOIRE DE CLIMATISATION A CONDENSATION PAR EAU COMPACTE HORIZONTAL/VERTICAL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	07115843	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	COOLING ONLY WATER CONDENSED HORIZONTAL/VERTICAL PACKAGED UNIT	1/5	400/3/50



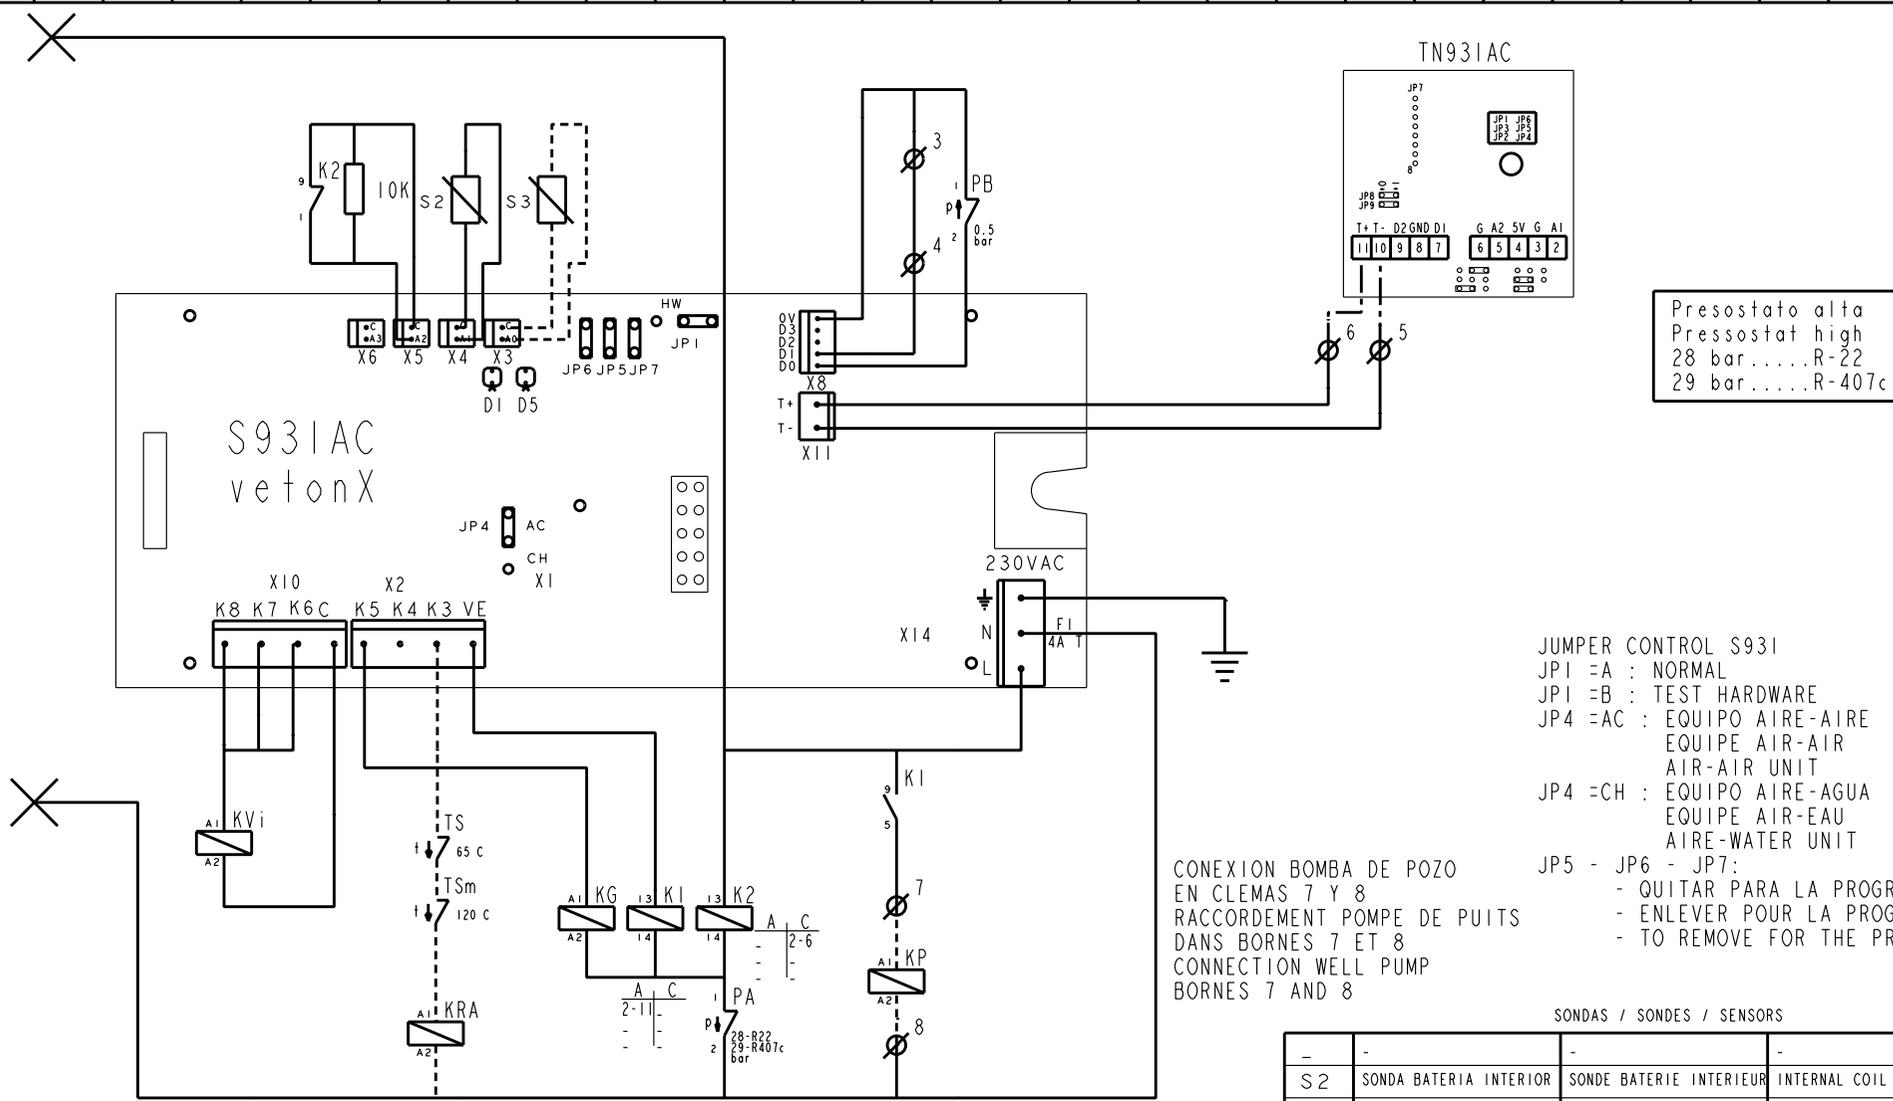

Presostato alta
 Pressostat high
 28 bar.....R-22
 29 bar.....R-407c

- JUMPER CONTROL S931
- JP1 =A : NORMAL
 - JP1 =B : TEST HARDWARE
 - JP4 =AC : EQUIPO AIRE-AIRE
EQUIPE AIR-AIR
AIR-AIR UNIT
 - JP4 =CH : EQUIPO AIRE-AGUA
EQUIPE AIR-EAU
AIRE-WATER UNIT
 - JP5 - JP6 - JP7:
 - QUITAR PARA LA PROGRAMACION
 - ENLEVER POUR LA PROGRAMMATION
 - TO REMOVE FOR THE PROGRAMMING

CONEXION BOMBA DE POZO
 EN CLEMAS 7 Y 8
 RACCORDEMENT POMPE DE PUIITS
 DANS BORNES 7 ET 8
 CONNECTION WELL PUMP
 BORNES 7 AND 8


SONDAS / SONDES / SENSORS

-	-	-	-
S2	SONDA BATERIA INTERIOR	SONDE BATERIE INTERIEUR	INTERNAL COIL SENSOR
S3	SONDA RETORNO (OPCION)	SONDE DE REPRIS (OPT.)	RETURN SENSOR (OPTIONAL)

MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	J.R.V.R.	FECHA: DATE: DATE:	01/02/08	SERIE :	RXH/V	MODELO: MODELE:	50/65/80 95/120/155	EQUIPO AUTONOMO CONDENSADO POR AGUA HORIZONTAL/VERTICAL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT	
MODIFICACION: MODIFICATION:	MAGNETOTERMICOS -			V° B°		NP:	08025843	ARMOIRE DE CLIMATISATION A CONDENSATION PAR EAU COMPACTE HORIZONTAL/VERTICAL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	07115843	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:		COOLING ONLY WATER CONDENSED HORIZONTAL/VERTICAL PACKAGED UNIT	2/5	400/3/50




TARJETA DE COMUNICACION RS485
 CARTE COMMUNICATION RS485
 COMMUNICATION CARD RS485

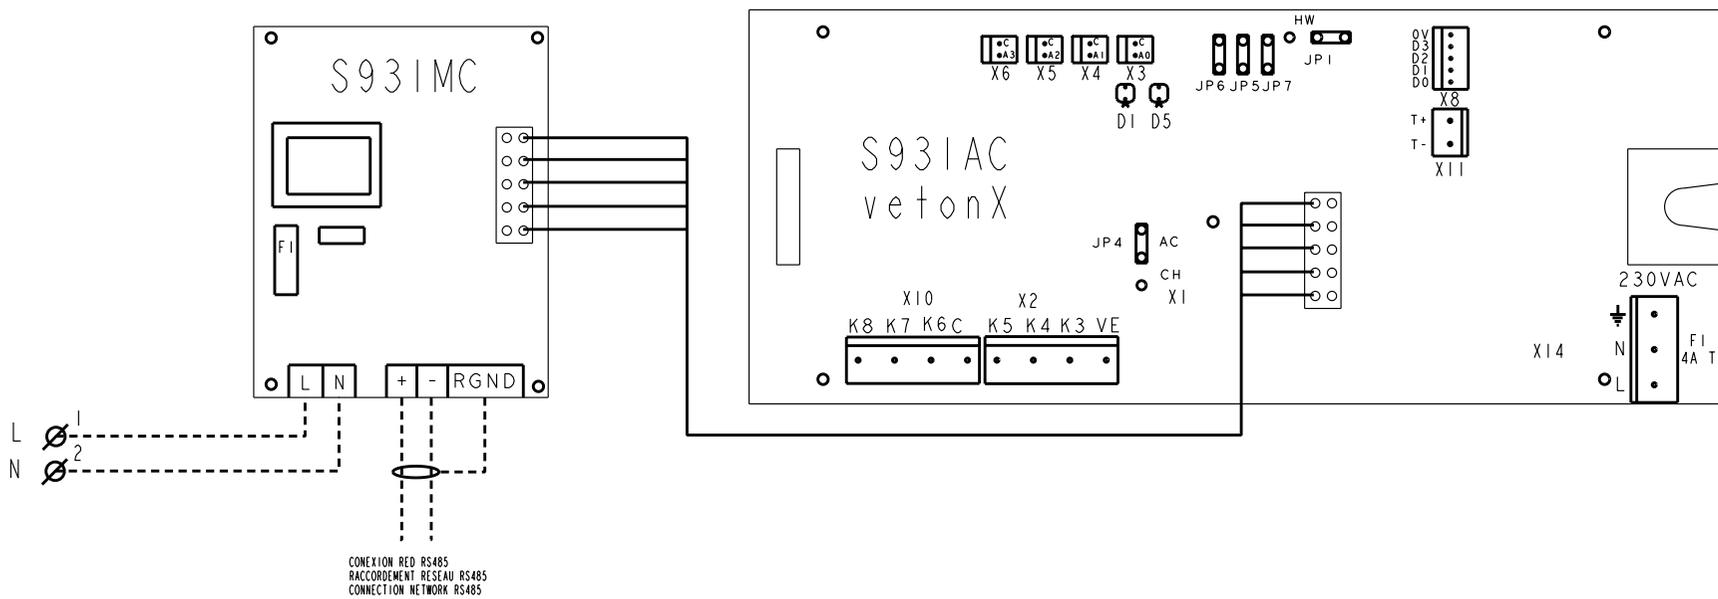


MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	J.R.V.R.	FECHA: DATE: DATE:	01/02/08	SERIE : RXH/V	MODELO: MODELE:	50/65/80 95/120/155	EQUIPO AUTONOMO CONDENSADO POR AGUA HORIZONTAL/VERTICAL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICACION: MODIFICATION:	MAGNETOTERMICOS -	v° B°		NP :	08025843	ARMOIRE DE CLIMATISATION A CONDENSATION PAR EAU COMPACTE HORIZONTAL/VERTICAL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	07115843	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-	CIATESA -CIAT GROUP-		COOLING ONLY WATER CONDENSED HORIZONTAL/VERTICAL PACKAGED UNIT	3/5	400/3/50

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30


IMPLANTACION DE PLETINA
 IMPLANTATION DE PLATINE
 ELECTRICAL PANEL LOCATION
 SERIE: RXH

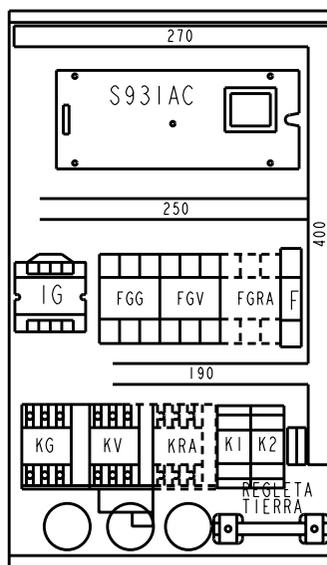

RXH-50/65

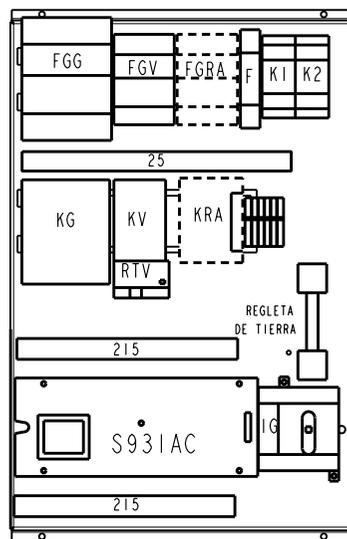

RXH-80/95

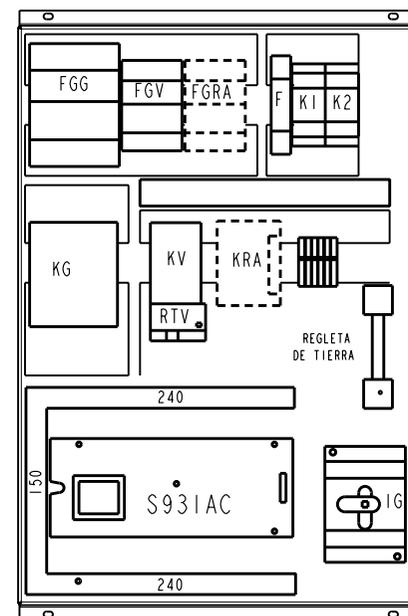


RXH-120/155

MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	J.R.V.R.	FECHA: DATE: DATE:	01/02/08	SERIE :	RXH/V	MODELO: MODELE:	50/65/80 95/120/155	EQUIPO AUTONOMO CONDENSADO POR AGUA HORIZONTAL/VERTICAL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT	
MODIFICACION: MODIFICATION:	MAGNETOTERMICOS -		v° B°			NP:	08025843	ARMOIRE DE CLIMATISATION A CONDENSATION PAR EAU COMPACTE HORIZONTAL/VERTICAL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	07115843	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	COOLING ONLY WATER CONDENSED HORIZONTAL/VERTICAL PACKAGED UNIT	4/5	400/3/50


CIATESA
 CIAT GROUP

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

IMPLANTACION DE PLETINA
 IMPLANTATION DE PLATINE
 ELECTRICAL PANEL LOCATION
 SERIE: RXV

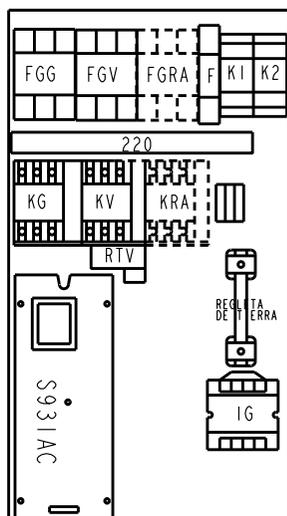

RXV-50/65

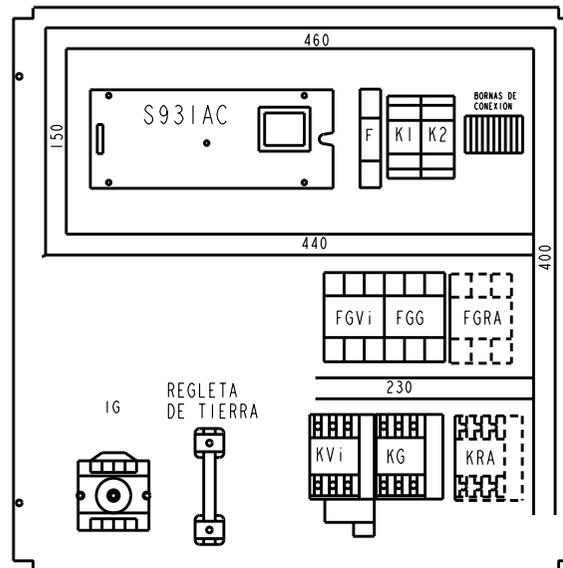

RXV-80/95/120/155

MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	J.R.V.R.	FECHA: DATE: DATE:	01/02/08	SERIE :	RXH/V	MODELO: MODELE:	50/65/80 95/120/155	EQUIPO AUTONOMO CONDENSADO POR AGUA HORIZONTAL/VERTICAL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT	
MODIFICACION: MODIFICATION:	MAGNETOTERMICOS -		v° B°			NP:	08025843	ARMOIRE DE CLIMATISATION A CONDENSATION PAR EAU COMPACTE HORIZONTAL/VERTICAL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	07115843	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	COOLING ONLY WATER CONDENSED HORIZONTAL/VERTICAL PACKAGED UNIT	5/5	400/3/50

